

**Project Name:** Portland ME - 2014 Precast - Concrete Testing

**Project Number:** 14-0433

**Client:** Beachstone

**Client Contract Number:**
**General Contractor:**
**Concrete Supplier:**

### PLACEMENT INFORMATION

**Date Cast:** 2/26/2015      **Time Cast:**      **Date Received:** 3/3/2015

**Placement Location:** KATAHDIN WHITE

**Placement Method:**
**Placement Vol. (yd<sup>3</sup>):**
**Cylinders Made By:**
**Aggregate Size (in):** 3/4

\* Test Cylinders Not Made By S. W. Cole Personnel

### INITIAL CURING CONDITIONS

#### Temperatures

**Minimum (°F)**                      **Maximum (°F)**

### DELIVERY INFORMATION

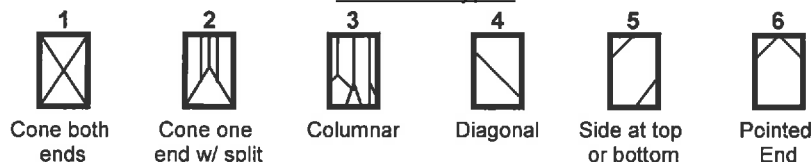
**Admixtures:**

### TEST RESULTS

**Slump (in) (C-143):**
**Load Number:**                      **Batch**
**Air Content (%) (C-231)**
**Mixer Number:**
**Air Temp (°F):**
**Ticket Number**                      **Arrive**
**Conc. Temp (°F) (C-1064):**
**Cubic Yards:**
**Depart**
**Design (psi):**

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) <sup>2</sup>	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
560-11A	3.35	3.00	7.07	3/5/2015	Lab	7	4	28.3	4000
560-11B	3.30	3.00	7.07	3/12/2015	Lab	14	4	34.6	4900
560-11C	3.35	3.00	7.07	3/26/2015	Lab	28	4	42.4	6000

#### Fracture Types


**Remarks:**