

Project Name: Portland ME - 2014 Precast Concrete Testing

Client: Beachstone

Date Received: 2/10/2015

General Contractor:

Concrete Supplier:

PLACEMENT INFORMATION

Date Cast: 2/9/2015

Time Cast:

Placement Vol. (yd³):

Aggregate Size (in):

Placement Location:

Placement Method:

Beams Made By:

DELIVERY INFORMATION

Admixtures:

* Test Beams Not Made By S. W. Cole Personnel

Load Number:

Mixer Number:

Truck Number:

Cubic Yards:

Weight (psi):

Width: Depth:

TEST RESULTS

Slump (in) (C-143):

Air Content (%) (C-231):



Air Temp (°F):

Conc. Temp (°F) (C-1064):

Beam Designation	Date Of Test	Age (days)	Location of Break "a"	Span Length
560-8A	2/16/2015	7	Middle 1/3	18
560-8B	3/16/2015	35	Middle 1/3	18

Flexure Strength of Concrete

ASTM C78	Load "P" (kips)	Modulus of Rupture (psi)
6	10.5	875
Project Number: 14.1		14-0498

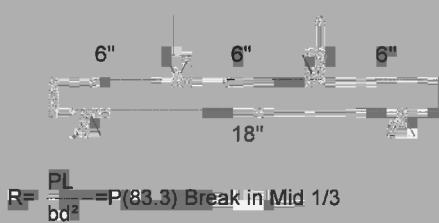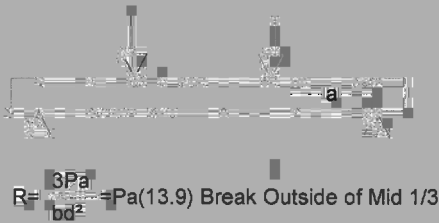

Remarks: